


This t'stat is non-adjustable, please do not play with the buttons...thanks.

## Cunz Hall

### Explanation Of Your Room Thermostat

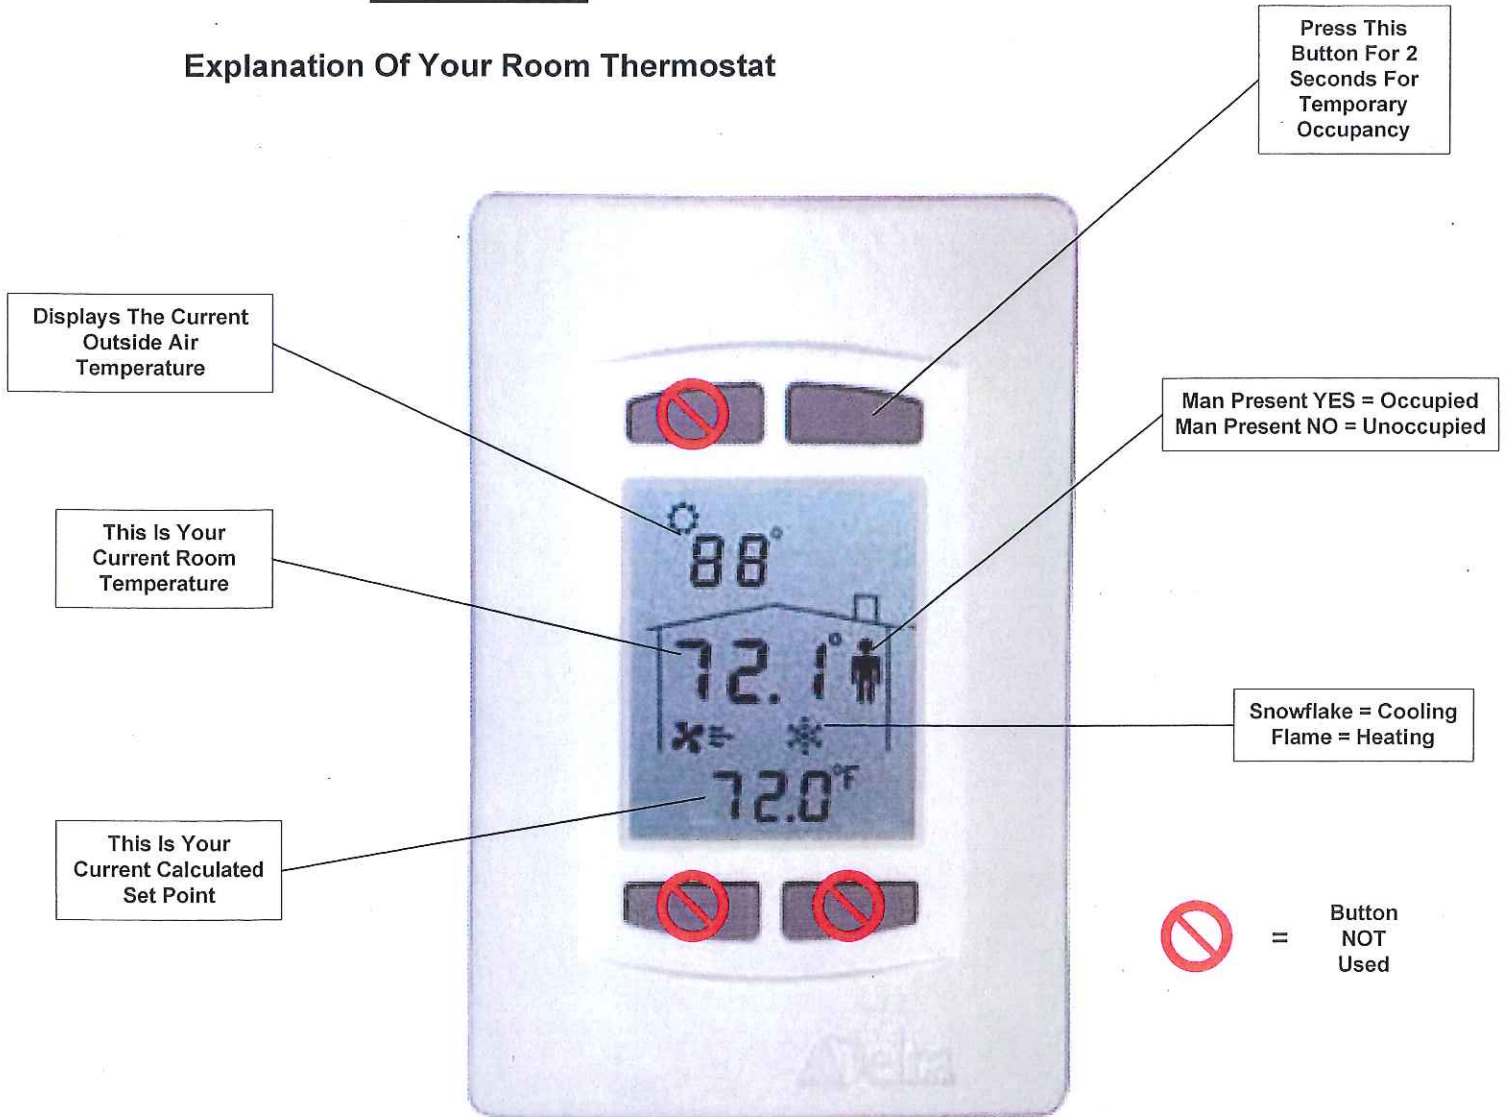

**Occupied Mode:** During normal business hours each space shall have its set point calculated based on outside air temperature in order to adhere to the Green Build Policy set forth by the University. Space set points will be non-adjustable and shall be calculated using the following:

If Outside Air Temperature is	Space Set Point shall be
57 or below	70
60	71
63	72
66	73
69	74
72	75
75 or greater	76

The system shall be allowed to either heat or cool based on the current space conditions as compared to the set point.

**Unoccupied Mode:** After normal business hours each space shall not try to control space temperature between 60 deg F and 80 deg F. If the space falls below 60 deg F then the system will warm the space back up by three degrees. If the space rises above 80 deg the system will cool the space back down by three degrees.

**Temporary Occupancy:** If the system is unoccupied and you are using the space after hours you may press the button in the upper right hand side for 2 seconds and the system shall go occupied for the next 2 hours.